


LHS INSIDE VIEW

FRONT INSIDE VIEW

RHS INSIDE VIEW

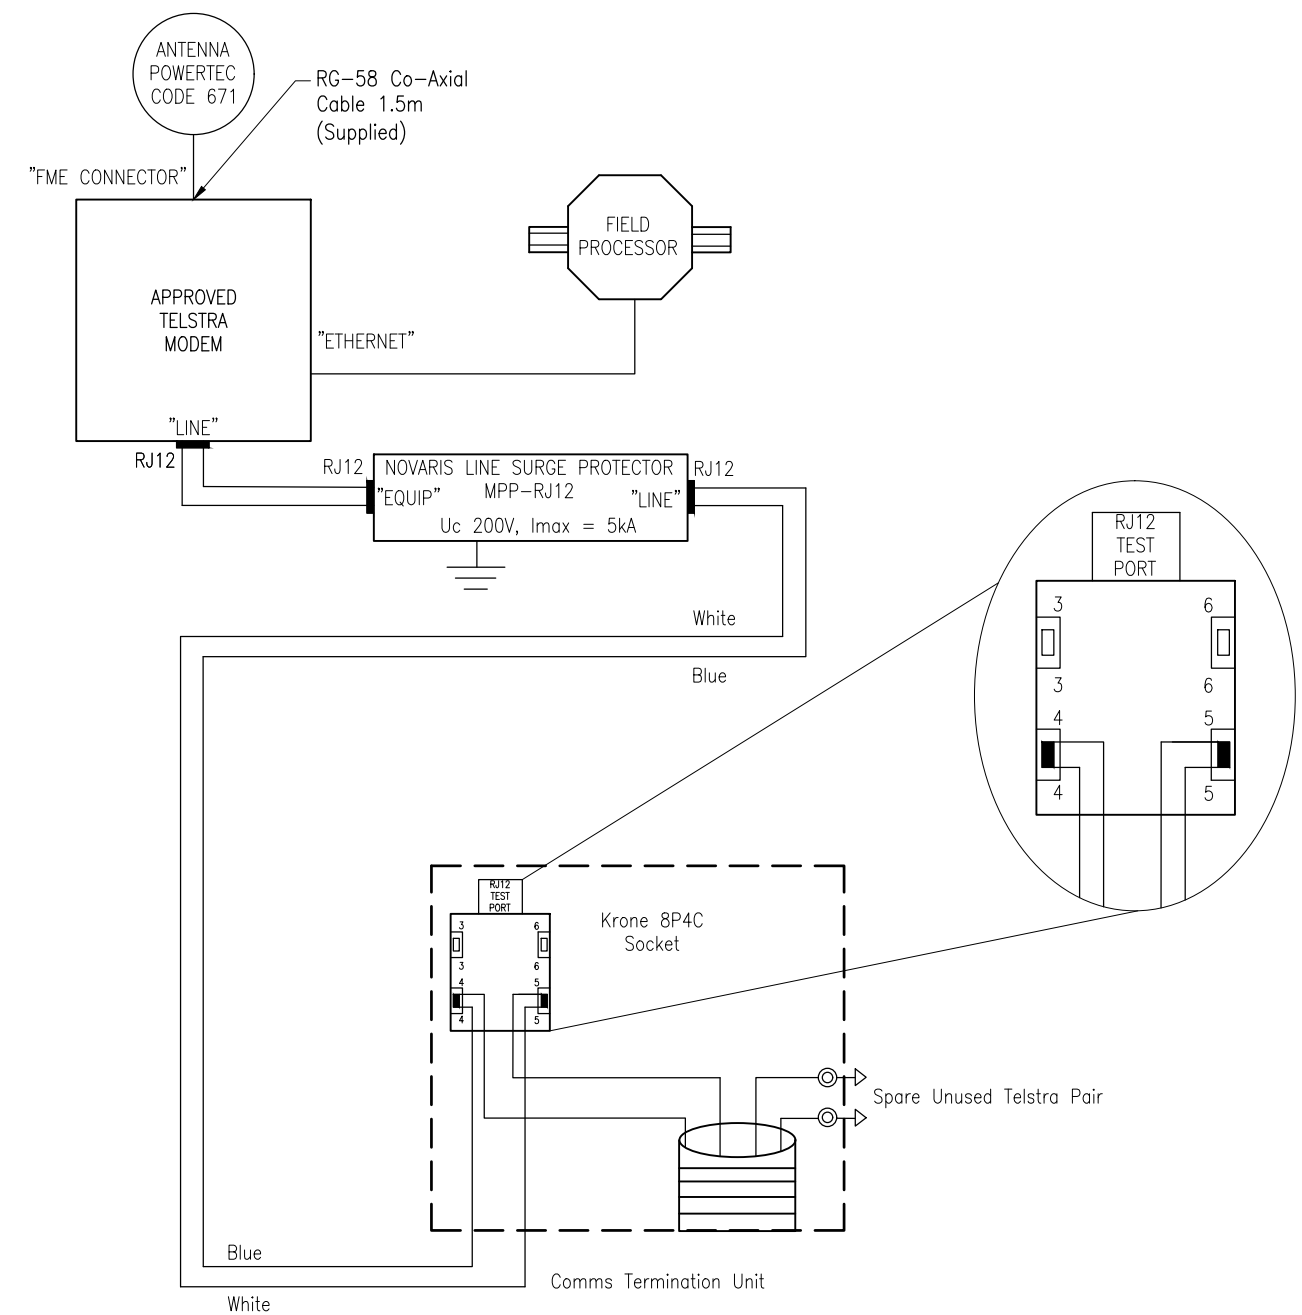

SCHEMATIC

NOTES

1. Transmax to supply FP-to-Controller module serial cable.
2. All electrical installation in accordance with AS/NZS 3000 and the Electrical Safety Act (QLD).
3. Specified antenna is Powertec Code 671 Next G antenna in grey colour with gasket.
4. Do not over tighten central locking nut or wingnut.

ASSOCIATED DEPARTMENTAL DOCUMENTS:
Standard Drawings Specifications

REFERENCED DOCUMENTS:
Departmental Standard Specifications:
MRTS201 General Equipment Requirements

Australian Standards:
AS/NZS 3000 Electrical Installations (Wiring Rules)

Department of Transport and Main Roads				© The State of Queensland (Department of Transport and Main Roads) 2020 http://creativecommons.org/licenses/by/3.0/au	
ITS IPRT NETWORK				A3	Standard Drawing No 1782 Date 3/2020
TYPICAL TRAFFIC CONTROLLER WITH TELSTRA MODEM AND ASSOCIATED NEXT G ANTENNA		Not to Scale	A	B	